

Inventory as of 05/10/2024


Dimension	Size	Qty	SqFt
10'x10'	100	35	3,500
Totals:		35	3,500

AMRPA  
 OCTOBER 29, 2024  
 JW MARRIOTT TURNBERRY  
 ROYAL BALLROOM 1-4  
 MIAMI, FL



2575 NORTHWEST PKWY  
 ELGIN, IL 60124  
 P: 847.426.3100  
 F: 847.426.3111  
 www.vipertradeshow.com

DATE  
 5.10.24  
 BOOTH COUNTS  
 ALL BOOTHS ARE 10' X 10'  
 UNLESS NOTED OTHERWISE

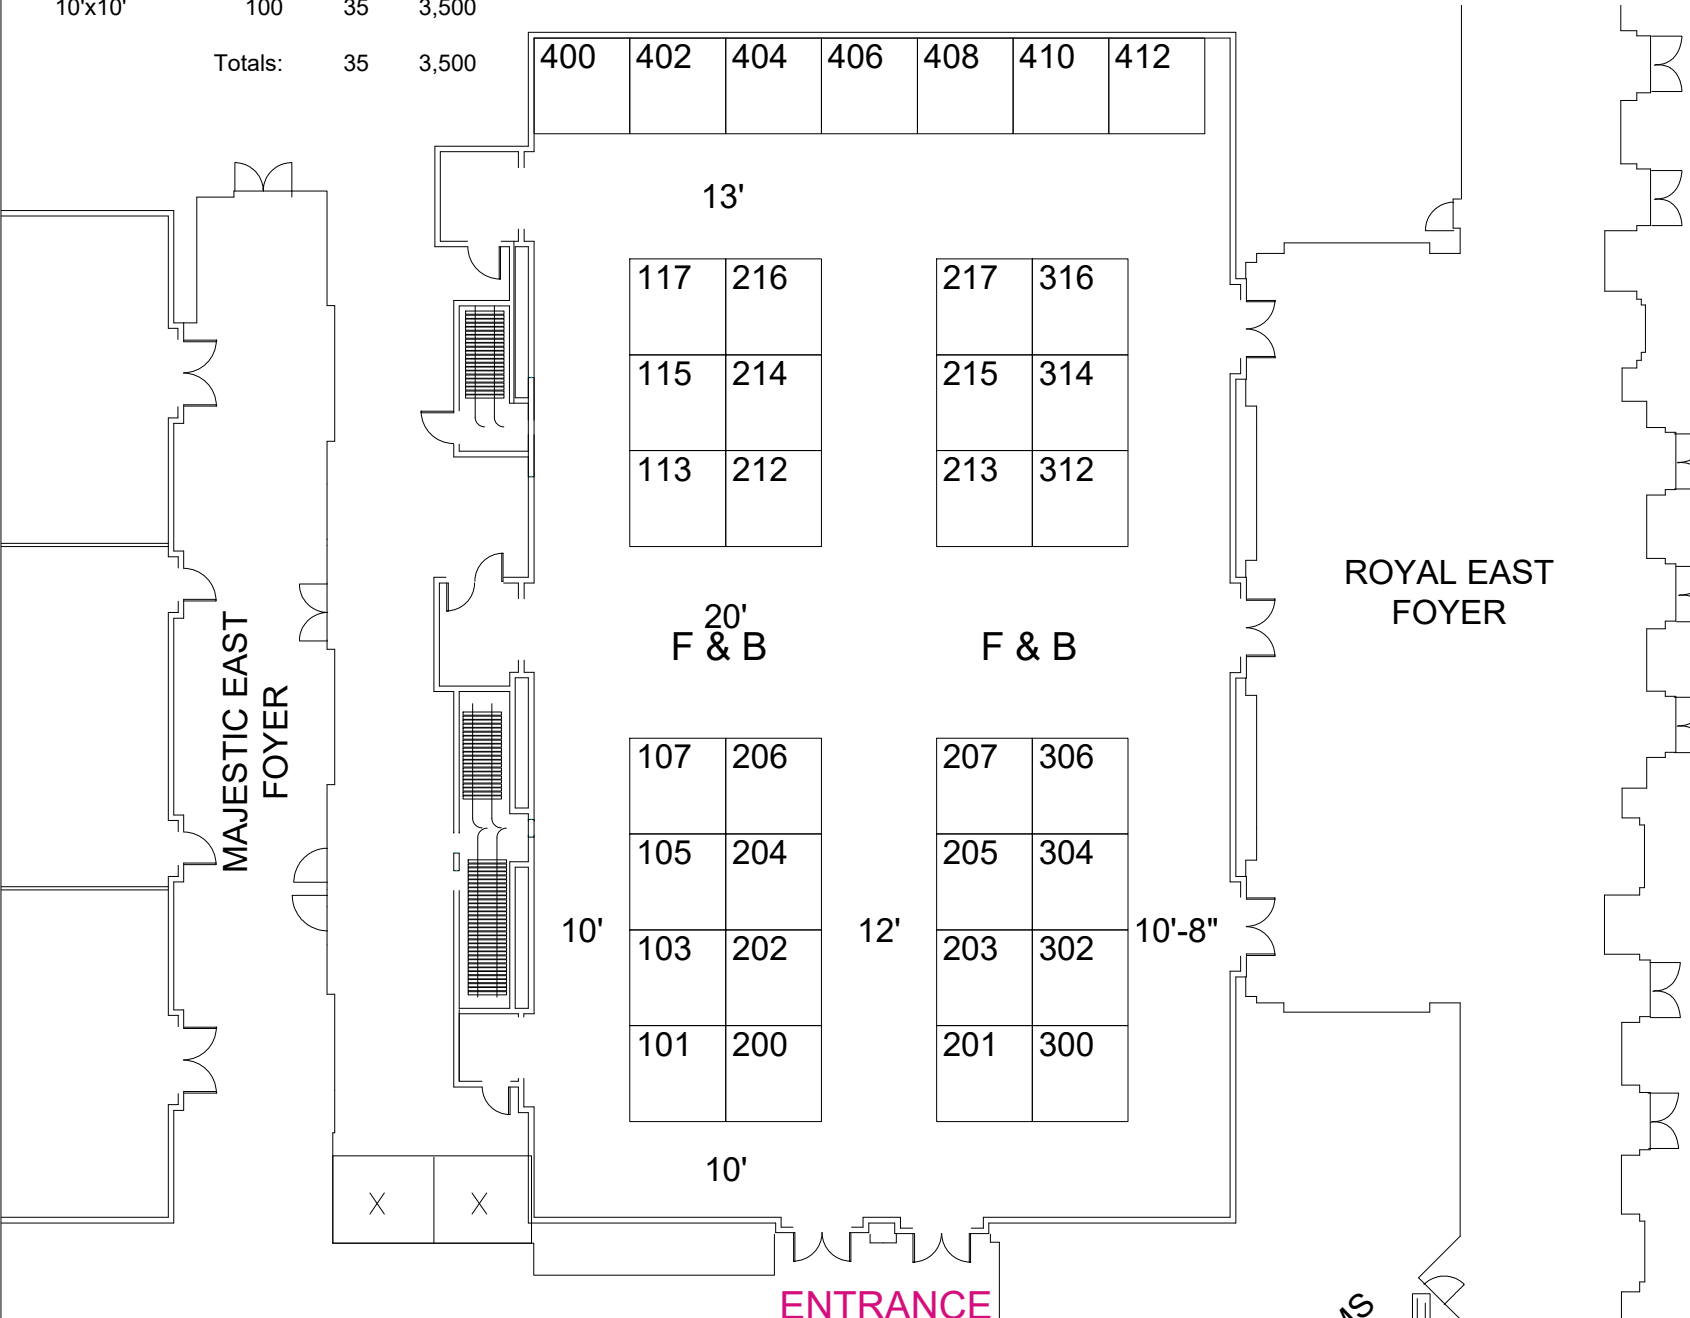

KEY  
 FE-FIRE EQUIPMENT  
 ALL EXITS 6' UNLESS NOTED  
 ALL DRAPE USED MEETS  
 FLAME RETARDANT FIRE CODE  
 SHOW INFO  
 SHOW OPENS:  
 SHOW CLOSES:  
 MOVE IN:  
 MOVE OUT:  
 CONTACT:  
 PHONE:

CAPACITY INFO  
 GUESTS: N/A  
 TOTAL SQ FT: 15912  
 USABLE SQ FT: 15912  
 MAX OCCUPANCY: 1060  
 MAX ALLOWED OCCUPANCY: 1060  
 EXIT FEET REQD: 17'  
 FIRE EXITS GIVEN: 100'  
 FIRE EXTINGUISHERS REQ: 5  
 FIRE EXTINGUISHERS GIVEN: N/A

DRAWN BY  
 M. MOSES  
 SCALE  
 1" = x UNITS  
 DISCLAIMER

Every effort has been made to ensure the accuracy of all information contained on this floor plan. However, no warranties, either expressed or implied, are made with respect to this floor plan. If the location of building columns, utilities or other architectural components of the facility is a consideration in the construction or usage of an exhibit, it is the sole responsibility of the exhibitor to physically inspect the facility to verify all dimensions and locations. Doors that are blocked or unavailable and are not needed to meet the minimum exit requirement will have exit signs covered. There will be no candles, pyro-technics or open flames that have not been properly permitted used in this event.

ROOM
MAX OCCUPANCY 15912 sqft divided by 15 = 1060 Linear footage of exits REQUIRED, 1060 divided by 60 = 17' Fire Exits Req, 1060 Times .02 = 21' Fire Exits Given: 100' Fire Extinguishers Req: 15912 sqft divided by 3000 = 5 Fire Extinguishers Given: N/A